

ERRATA for
PE Mechanical Engineering: HVAC and Refrigeration Practice Exam
ISBN: 978-1-932613-76-6
Copyright 2016
Errata posted 2/17/2017

p. 102:

The correct psychrometric chart is shown on the next page.





ASHRAE PSYCHROMETRIC CHART NO. 1

NORMAL TEMPERATURE
BAROMETRIC PRESSURE: 29.921 INCHES OF MERCURY

Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.

SEA LEVEL

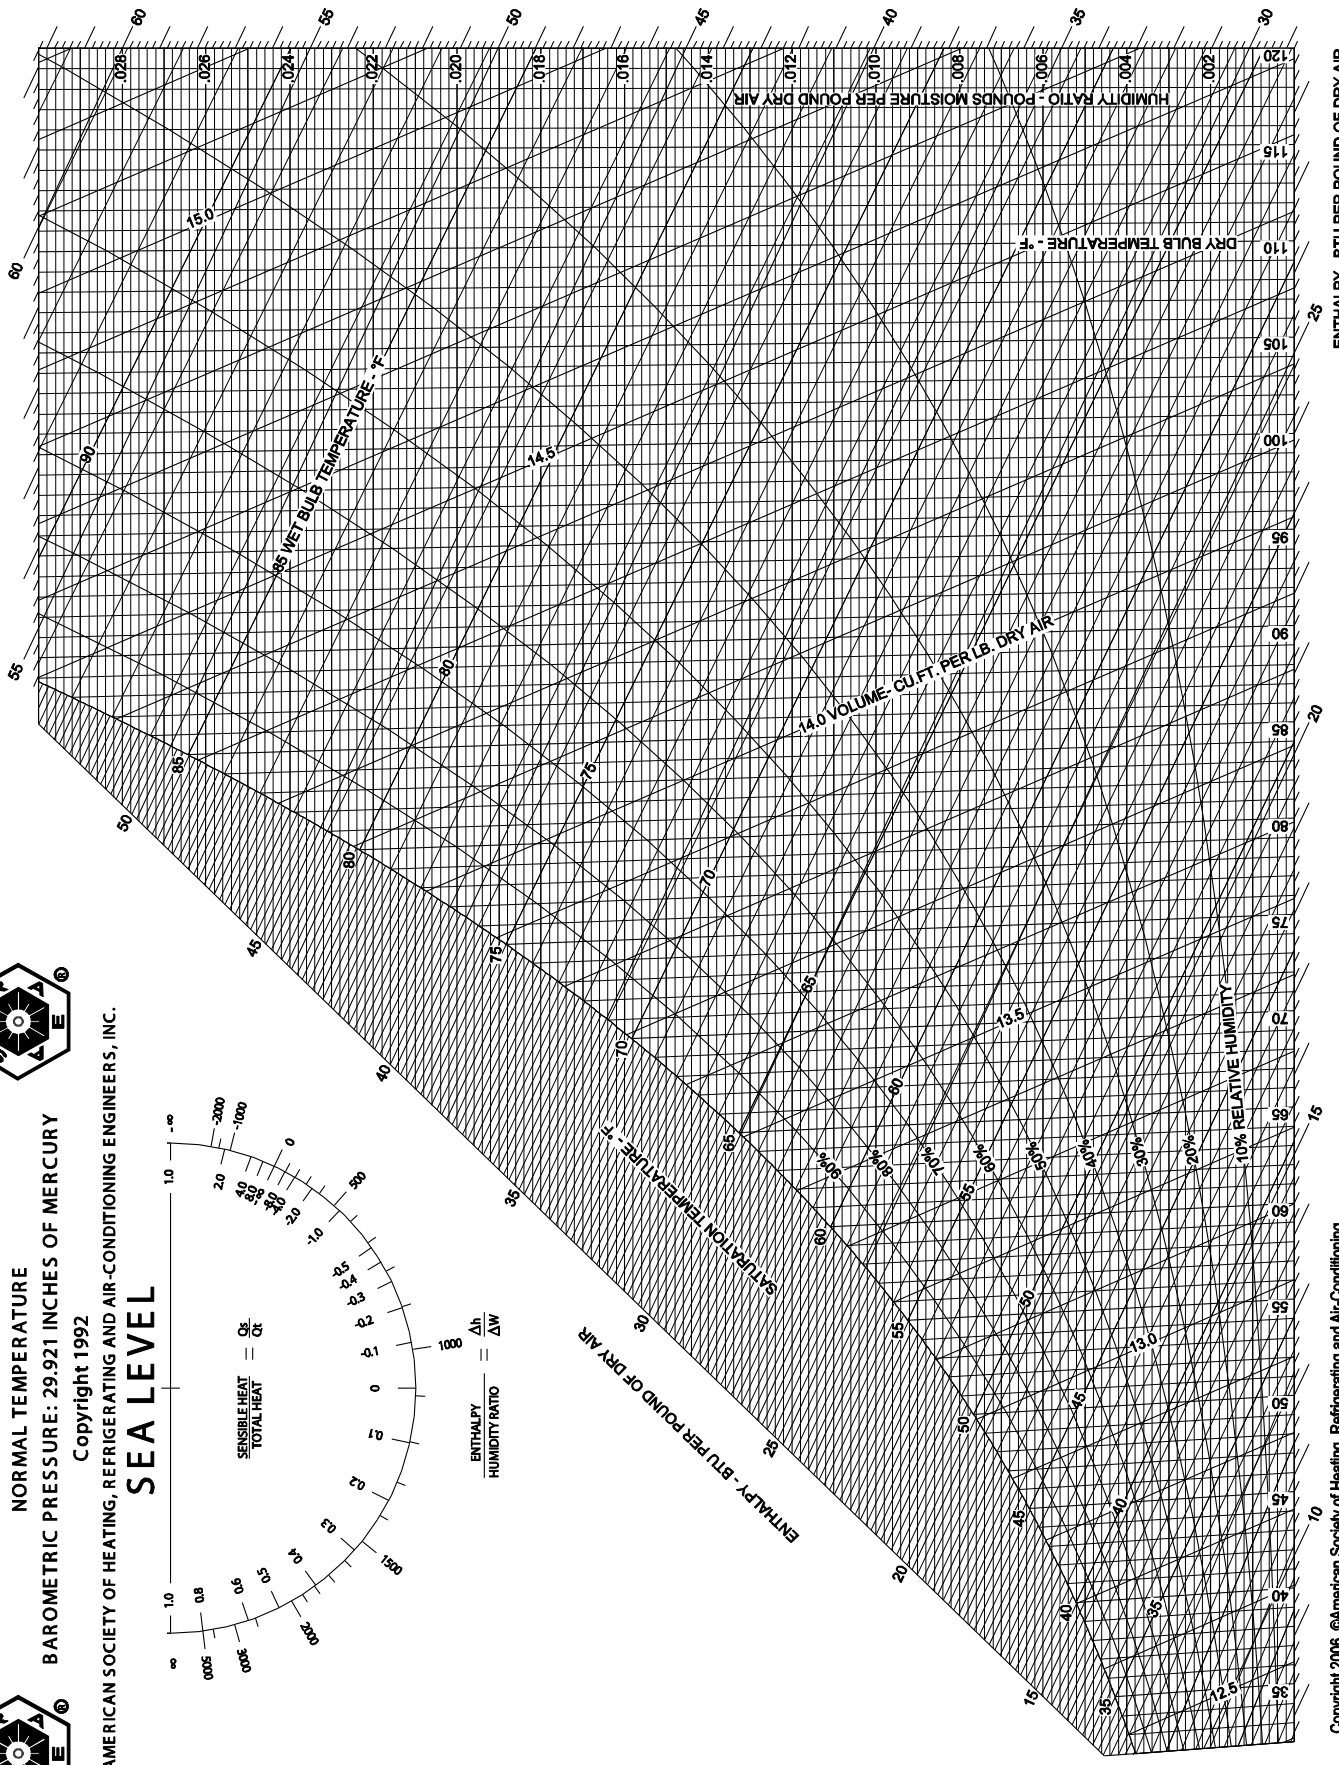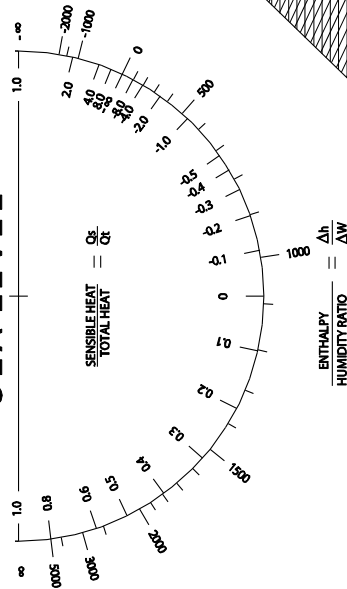

Copyright 2008, ©American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc. (www.ashrae.org). Reprinted by permission from ASHRAE. This chart may not be copied or distributed in either paper or digital form without ASHRAE's permission.